

NORMAL OPERATION EXHAUST FLOW

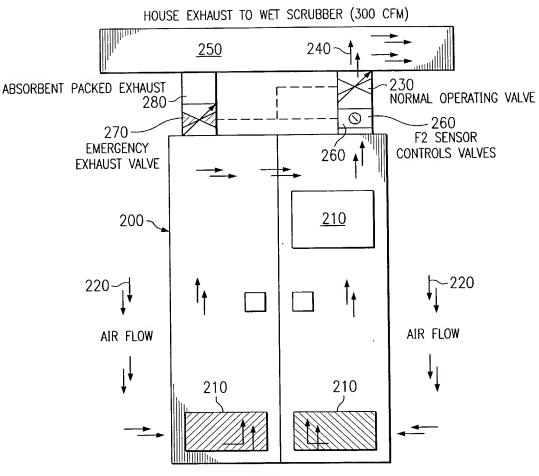


FIG. 4

EMERGENCY EXHAUST

HOUSE EXHAUST TO WET SCRUBBER (300 CFM)





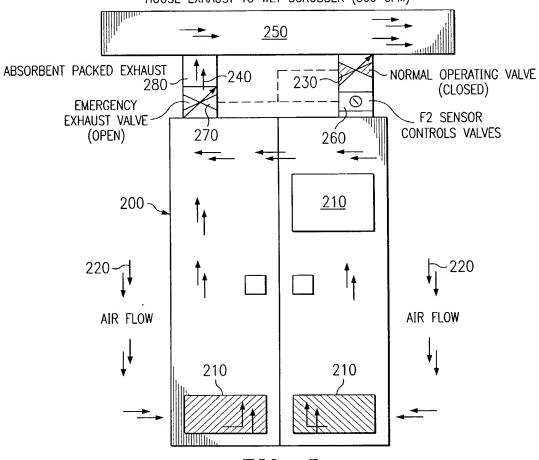


FIG. 5

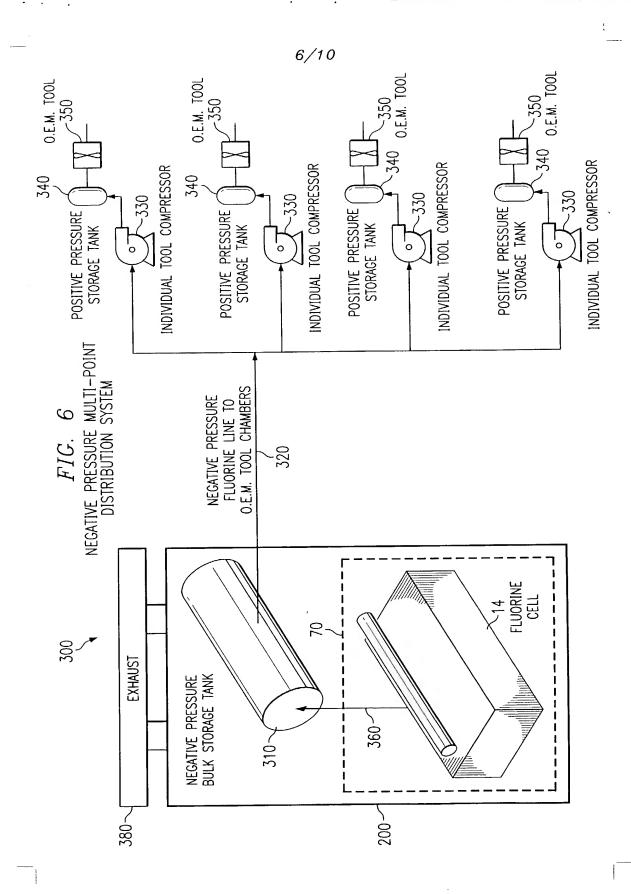

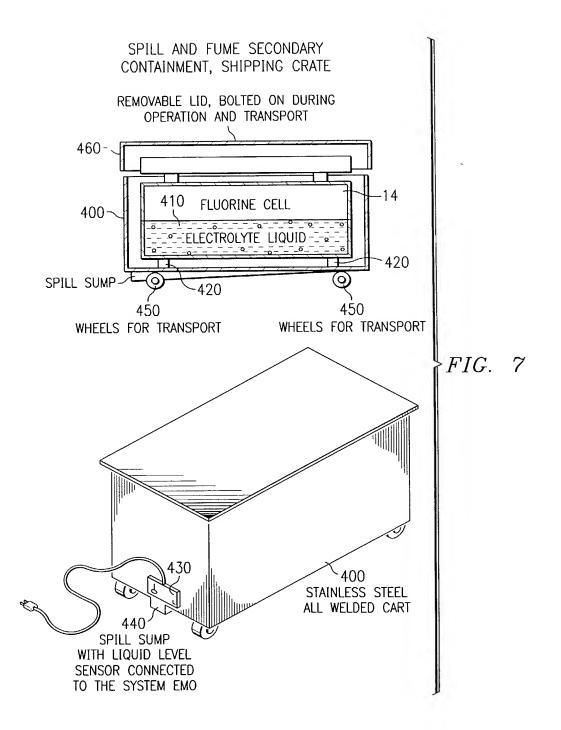

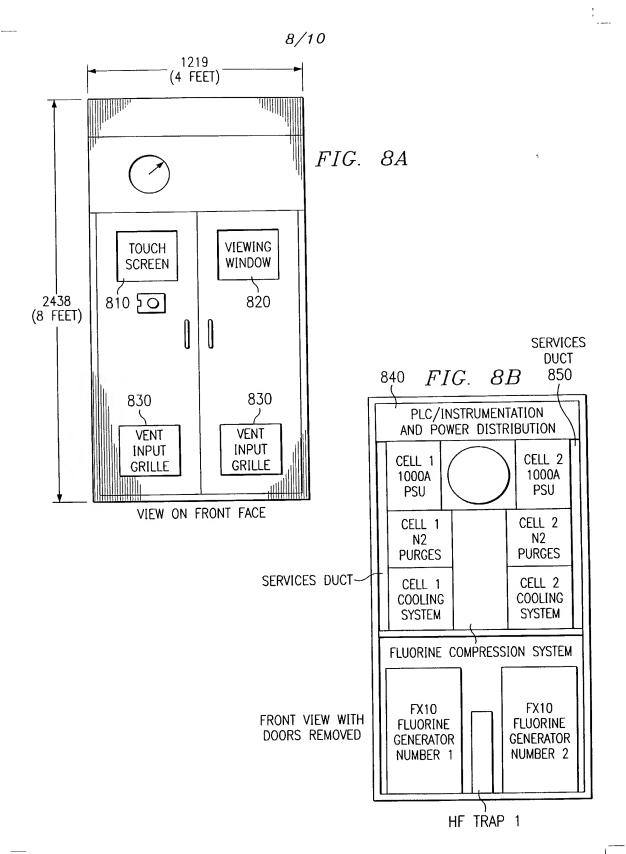

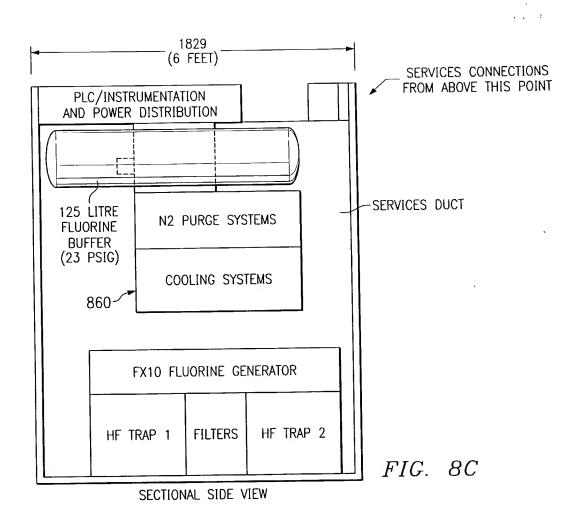

10/10

FIG. 9A



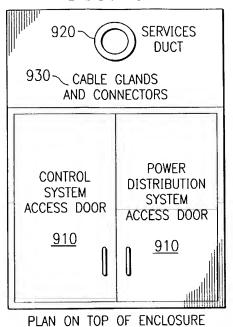


FIG. 9B

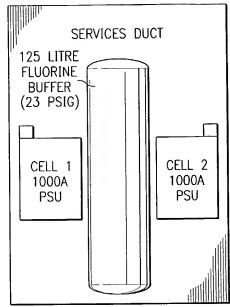


PLAN ON PSU's AND STORAGE VESSEL

FIG. 9C

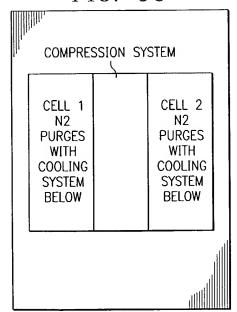

PLAN ON F2 COMPRESSION, PURGE AND COOLING SYSTEMS

FIG. 9D

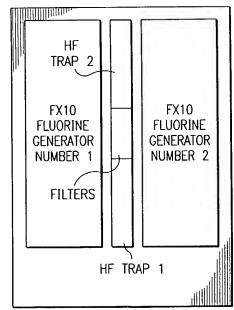

PLAN ON CELLS HF TRAPS AND FILTER